

CoolMax SRX Charge Controller

Installation and Operation User Manual



aerl
QUALITY


AUSTRALIAN
MADE

TUV
CERTIFIED

MODELS:
SRX 600/55-48
SRX 600/70-48

About AERL

Australian Energy Research Laboratories (AERL) was founded by Stuart Watkinson (BE Elec. Eng., Grad. M.I.E.A) in 1985 to commercialize the “Power Optimizer”, a revolutionary solution to a complex problem, developed while studying at the University of Queensland in Brisbane, Australia.

Stuart possessed not only a great idea but also the entrepreneurial skill to turn it into a commercially viable product, and the “Power Optimizer” would eventually come to be known as the AERL MAXIMIZER™, the world’s first truly Universal Maximum Power Point Tracker (MPPT).

Today, AERL manufactures a range of highly reliable and efficient specialized power products for use in Solar, Micro Hydro, Micro Wind, and Cathodic Protection applications.

Contact Information

Australian Energy Research Laboratories

75 Bluestone Circuit,
Seventeen Mile Rocks, 4073,
Queensland, Australia

+61 1800 950 865
sales@aerl.com.au
www.aerl.com.au

Disclaimer

UNLESS SPECIFICALLY AGREED TO IN WRITING, AUSTRALIAN ENERGY RESEARCH LABORATORIES:

(a) MAKES NO WARRANTY AS TO THE ACCURACY, SUFFICIENCY OR SUITABILITY OF ANY TECHNICAL OR OTHER INFORMATION PROVIDED IN ITS MANUALS OR OTHER DOCUMENTATION.

(b) ASSUMES NO RESPONSIBILITY OR LIABILITY FOR LOSS OR DAMAGE, WHETHER DIRECT, INDIRECT, CONSEQUENTIAL, OR INCIDENTAL, WHICH MIGHT ARISE OUT OF THE USE OF SUCH INFORMATION.

THE USE OF ANY SUCH INFORMATION WILL BE ENTIRELY AT THE USER’S RISK.

Notice of Copyright

CoolMax SRX Charge Controller User Manual © 2024 by AERL Pty. Ltd. All Rights Reserved.

Trademark

AERL and the AERL Logo are trademarks owned by AERL Holdings Pty. Ltd. and used by AERL Pty. Ltd under license. These trademarks may be registered in Australia and other countries.

Effective Date

November 2024 (11/2024)

Table of Contents

Warranty Conditions	4
Specifications	5
Introduction	5
■ Features	6
■ Firmware	6
Installation	7
■ Standards & Requirements	7
■ Grounding	7
■ Mounting the Controller	8
■ Mounting Clearances	8
■ Wiring Information	9
■ Wire and Disconnect Sizing	9
■ CoolMax SRX 600/55–48	9
■ CoolMax SRX 600/70–48	9
■ Removing the Access Cover	10
■ Wiring Compartment	11
Operation	12
■ Start-Up & Shutdown Procedure	12
■ Programming the Device	12
■ Device Status Indicator	13
■ Battery Charge Profile	14
■ Charge Profile Configuration	15
■ Setting the Battery Charge Profile with AERL Link	16
■ Battery Temperature Compensation	17
■ Connecting the Temperature Sensor	17
■ Temperature Sensor Location	17
■ Earth Fault Detection	18
■ Earth Fault Sensitivity	18
■ Communications Protocols	19
Troubleshooting – Error Codes	20

Important Safety Information

This Installation Manual contains important safety information and installation instructions for the AERL COOLMAX SRX MPPT Solar Charge Controller.

The following symbols are used throughout this user manual to indicate ideal installation methods, potentially dangerous conditions, and important operational information.

IMPORTANT

Indicates information that must be followed to ensure proper installation or operation of the COOLMAX SRX.

CAUTION

Indicates a critical procedure for the safe installation or operation of the COOLMAX SRX.

About this Manual

- This User Manual provides detailed installation and usage instructions for the COOLMAX SRX. It is recommended that all the Instructions and Cautions in this User Manual be read before beginning installation.
- Only qualified electricians and technicians should install the COOLMAX SRX. This manual is intended for all installation technicians and the system owner.
- Do not disassemble or attempt to repair the COOLMAX SRX unless you are a qualified technician and have authority in writing from AERL to do so.
- AERL will not be held responsible in any way for the mishandling of this product or for installation of the product in a manner that does not follow the instructions in this manual or as advised by an AERL.

Warranty Conditions

¹Warranty Duration from the Date of Purchase

Warranty Requirements	Total Warranty Duration
You are the original purchaser of the CoolMax SRX.	5 Years
You are the original purchaser of a CoolMax SRX model, and you have purchased the Plus 5 warranty extension from AERL.	10 Years

Our goods come with guarantees that cannot be excluded under the Australian Consumer Law. You are entitled to a replacement or refund for a major failure and compensation for any other reasonably foreseeable loss or damage. You are also entitled to have the goods repaired or replaced if the goods fail to be of acceptable quality and the failure does not amount to a major failure.

AERL will bear the cost of parts and labour to repair any manufacturing faults found within the terms and period of this warranty and pay the cost of freight to return the repaired CoolMax SRX controller within Australia/New Zealand but the method of freight will be determined by AERL.

An allowance is made for the labour required to disconnect or reinstall faulty parts up to the value of \$220 AUD excluding GST.

All installation and user conditions as set down in the instruction manual must be strictly adhered to as failure to do so may void your warranty. Any faults or like faults caused by lightning, water or moisture ingress, vermin infestation, improper voltage, faulty installation, use of the product in a manner for which it is not intended, alterations which affect the reliability or performance of the unit but are not attributable to faulty manufacture, or damage caused by other system components will not be covered under warranty.

In the event of the product being out of service, AERL shall bear no responsibility for any consequential loss or expense. AERL will not be held responsible for any misleading or incorrect information conveyed by anyone not directly employed by AERL.

For claims under warranty, the faulty product(s) must be returned to AERL's facility at 2/75 Bluestone Circuit, Seventeen Mile Rocks, 4073, QLD, Australia after contacting AERL and receiving the appropriate RMA documentation from AERL.

Note: Warranty conditions remain current until the next revision of this document is published. Proof of purchase is required when making a warranty claim.

Specifications

General Specifications		
Parameter	Typical	
Weight	5.65 kg	
Dimensions (H x W x D)	432 x 192 x 89 mm	
Enclosure Type	Indoor Type 1 / IP20	
Mounting Method	Wall Mount Bracket	
Input / Output Power Connectors	Screw Terminals (8 mm ² -> 42mm ²)	
Characteristics	SRX 600/70-48	SRX 600/70-48
Nominal Battery Voltage / Vdc Range	24 V 48 V / 20 - 60	24 V 48 V / 20 - 60
Max Charge Current	55 A	70 A
Nominal Charge Power	1584 W @ 24 V 3168 W @ 48 V	2016 W @ 24 V 4032 W @ 48 V
Max PV Input Power	Nominal Charge Power x 2	Nominal Charge Power x 2.0
Max PV Input Voltage (Voc)	600 V	600 V
MPP Voltage Range (Vmp)	170 - 500 V	170 - 500 V
Min PV Operating Voltage	100 V	100 V
Max PV Input Current (Imp)	18 A	18 A
Max PV Short Circuit Current (Isc)	25 A	25 A
Device Startup Voltage	24 V	24 V
Total Backfeed Current (Ibf Total)	0 A	0 A
Overload Behavior	Power Limitation	Power Limitation
PV Reverse Polarity Protection	Yes	Yes
Earth Leakage Current Detection	Yes	Yes
Overvoltage Category	DC II	DC II
Overvoltage Protection	DC Type II	DC Type II
Safety Protection Class	I	I
Pollution Degree (Int & Ext)	III	III
Max Altitude Rating	2000m	2000m
Max Conversion Efficiency	96.2%	96.2%
Ambient Operating Temperate Range (Maximum Charge Current derates by up to 10% Per ° C above 80% Ambient ° C)	-20 to +50 °C	-20 to +50 °C
Storage Temperature	-30 to +70 °C	-30 to +70 °C
Self-Consumption @ Idle	3 W	3 W
Allowable Relative Humidity	95% (Non-Condensing)	95% (Non-Condensing)
Cooling Method	Active (User Serviceable)	Active (User Serviceable)
Communications	RS485 / CAN Bus	RS485 / CAN Bus
Certifications	IEC62109-1:2010 EN61000.6.3:2012 EN61000.6.4:2012	IEC62109-1:2010 EN61000.6.3:2012 EN61000.6.4:2012

Thank-you for purchasing an Australian made CoolMax 600 Series Charge Controller.

CoolMax Charge Controllers offer an efficient and reliable charging process that not only maintains battery efficiency and life but maximizes power generation by unleashing the full potential of your PV array.



Features

CoolMax Charge Controllers utilize an advanced form of Maximum Power Point Tracking (MPPT) technology to extract the maximum power available from your PV array, efficiently charging your batteries and maximizing power generation.

AERL's Maximum Power Point Tracking (MPPT) algorithm has been proven to be highly robust, resistant to local extremes, and results in power losses of less than 0.5% over the whole operating temperature range of a PV Array.



**High Input Voltage
for Ease of Install**



**On-Board Ground
Fault Detection**



**PV Array Oversizing
Support (+200%)**



**Compatible
with most
Battery Systems**



**Reverse Polarity and
Current Protection**



**Built-In Overload and
Thermal Protection**



**Designed for
Long Term Reliability**



Australian Made

Firmware

This user manual covers CoolMax SRX Control Firmware Revisions v2.6.0 and above.

Installation

■ Standards & Requirements

All installations must comply with national and local electrical standards and codes of practice.



IMPORTANT

The CoolMax SRX must be installed in a clean, dry location away from direct sunlight on a flame retardant or non-flammable surface.

AERL always recommends professional installation. No on-going maintenance is required.



CAUTION – Hazard

Ensure the SOLAR ISOLATOR/BREAKER is in the OFF position before connecting or disconnecting the MPPT Charge Controller.

■ Grounding

CoolMax Charge Controllers are designed to be installed in floating systems but contain provisions for positive functional earthing for telecom applications if required.



IMPORTANT

DO NOT FUNCTIONALLY EARTH THE ARRAY if a negative earth is used for the batteries, load, or DC system.



CAUTION – Hazard

The Chassis Ground (located inside the enclosure) is marked with the following symbol:



CAUTION – Hazard

If damaged or malfunctioning, the AERL controller should only be disassembled and repaired by a qualified service centre. Please contact your local authorized distributor for assistance. Incorrect reassembly risks malfunction, electric shock, or fire.

■ Mounting the Controller

Use the mounting plate included with the controller to mount the CoolMax SRX on a vertical surface as demonstrated in **Figure 1A** below.

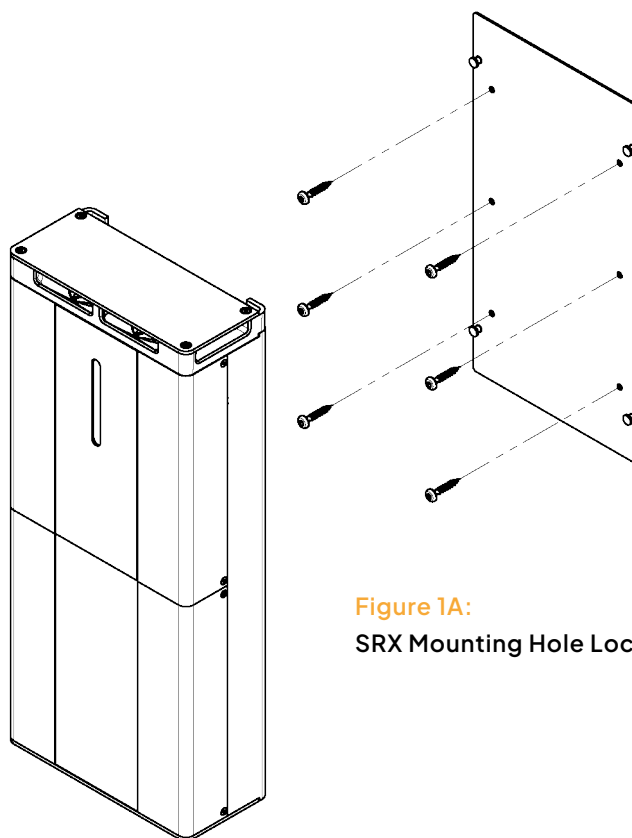


Figure 1A:
SRX Mounting Hole Locations

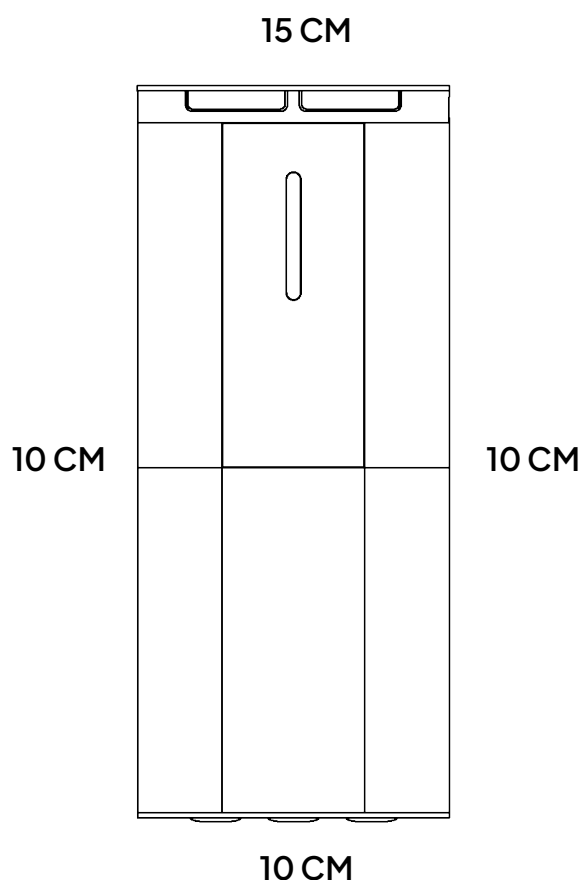


Figure 1B:
SRX Mounting Clearances

■ Mounting Clearances

When mounting the CoolMax SRX, a clearance zone around the device must be adhered to for optimal cooling of the controller under full load, as demonstrated in **Figure 1B** below.

■ Wiring Information

This section will provide information and instructions for safely wiring up the DC connections on the CoolMax SRX.

■ Wire and Disconnect Sizing

This section will provide information and instructions for safely wiring up the DC connections on the CoolMax SRX.



IMPORTANT

- Wire sizes must comply with local and national standards. Input conductors and circuit breakers must be rated at 1.56 times the short-circuit current of the PV array.
- Copper wiring must be rated at 75°C or higher.

Use a minimum of #6 AWG (16 mm²) high strand count double insulated cable for the output between the CoolMax and the battery bus bar or termination, and we recommend you use an appropriately sized insulated crimp ferrule when terminating both the input and output connections.

Torque all CoolMax wire and ground terminals to 1.7 Nm (15 in-lb).

■ CoolMax SRX 600/55–48

- The output current limit of the CoolMax SRX 600/55–48 is 55A.
- Use a **65–125A Non-Polarized DC Circuit Breaker** between the controller output and load as short circuit protection and a point of isolation.
 - **Recommended Option:** ZBeny BDM-125 DC Breaker

■ CoolMax SRX 600/70–48

- The output current limit of the CoolMax SRX 600/70–48 is 70A.
- Use an **80–125A Non-Polarized DC Circuit Breaker** between the controller output and load as short circuit protection and a point of isolation.
 - **Recommended Option:** ZBeny BDM-125 DC Breaker

Please refer to the relevant IEC or AS/NZS electrical code for recommendations on PV array cable sizing, length, and ampacity.

All devices connected to the controller must have suitable insulation in accordance with the relevant product standards.

■ Removing the Access Cover



CAUTION – Hazard

All CoolMax SRX wiring must enter the unit through the entry ports located in the base and rear of the enclosure.

Under absolutely **no circumstances** should holes be drilled anywhere into the unit to make other cable entry points. Doing so can cause metal swarf or fillings to enter the internal electronics and damage the unit once powered up.

To install cabling, the access panel cover must be removed. This is done by removing the two M4 countersunk Phillips screws on the bottom of the enclosure and the four M3 countersunk Phillips screws on either side as demonstrated in Figure 2 below.

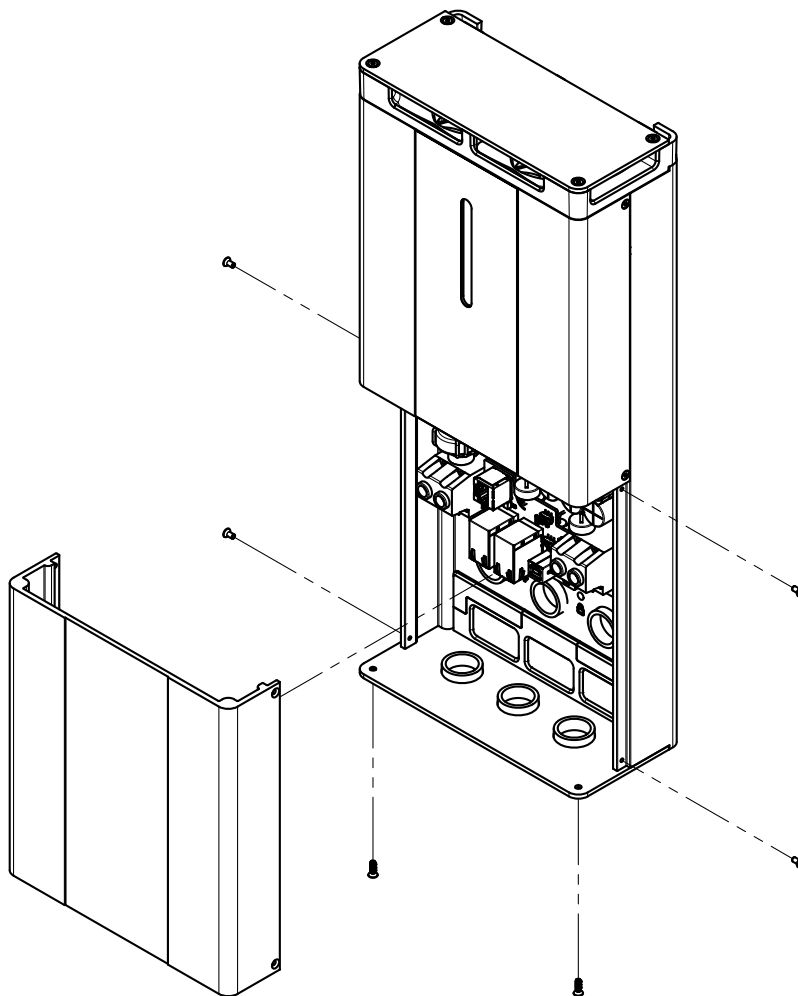


Figure 2: SRX Access Panel Screw Locations

■ Wiring Compartment



CAUTION – Hazard

Reversing the polarity of either the input or output may damage the CoolMax SRX and void product warranty.

Confirm polarity with a multi-meter prior to closing the input and output circuit breakers.

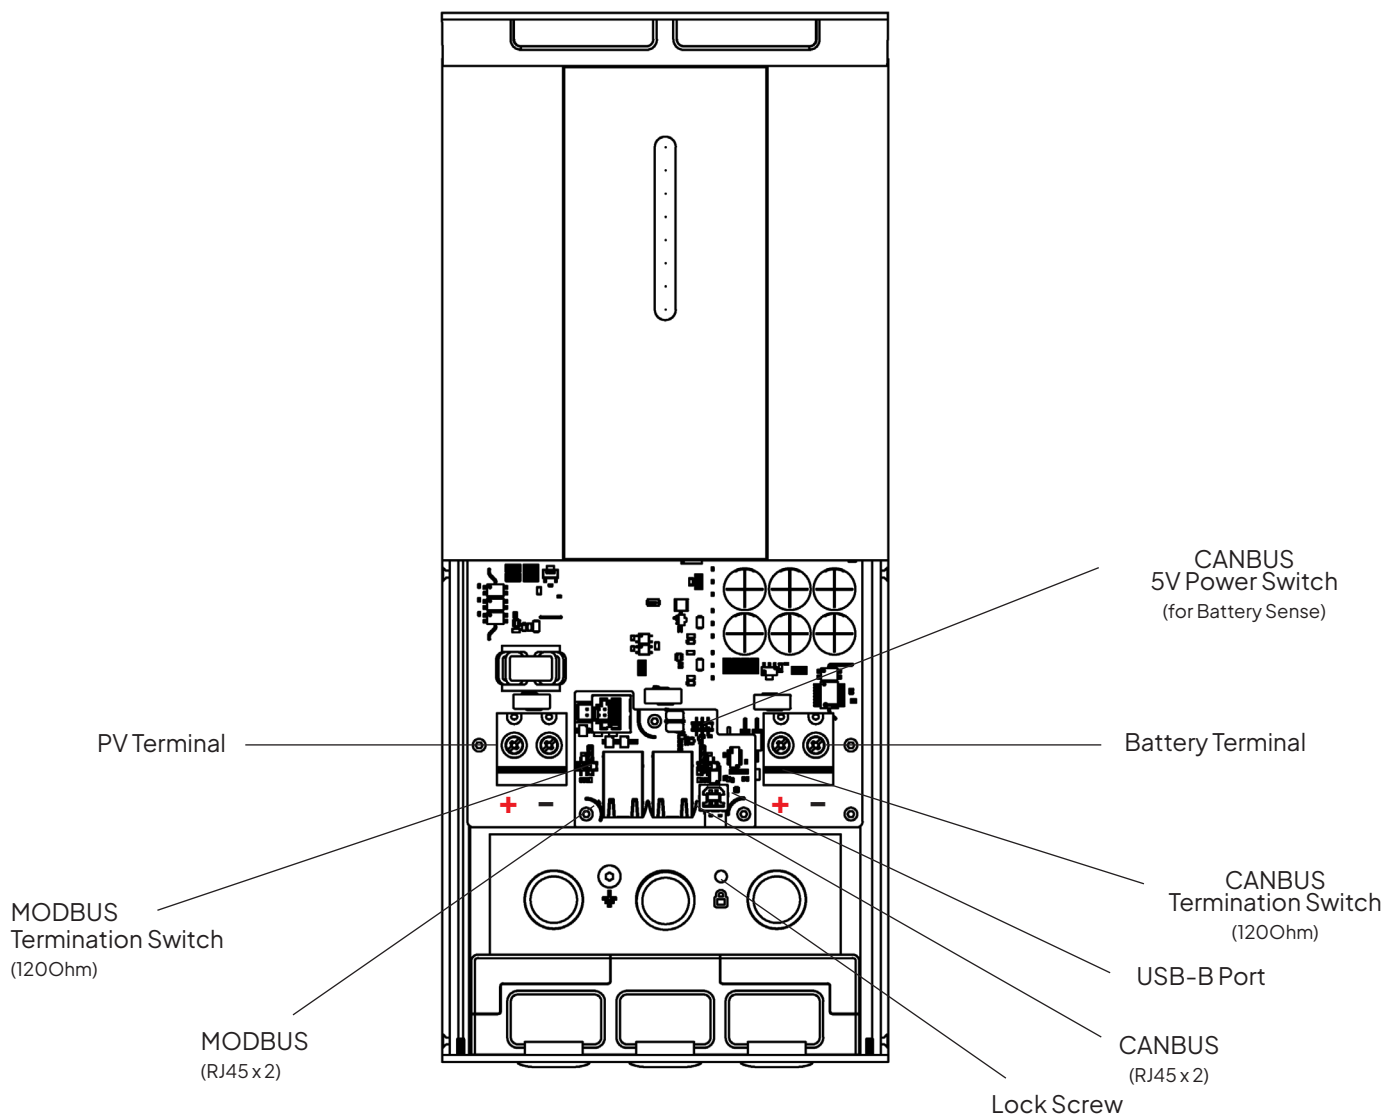


Figure 2: SRX Access Panel Screw Locations

Operation

■ Start-Up & Shutdown Procedure

The CoolMax SRX will start-up when a voltage above 30Vdc is applied to the PV Input – The device will not power up from the Battery terminal.

To start the device, connect the Battery first, and then turn the PV Isolator/Breaker on. The LED will flash blue for approximately 60 seconds, and then begin to charge – USB setup will be required on first start-up.

To shut down the device, turn the PV Isolator off, wait for the LED to turn off, and then disconnect the battery breaker to isolate the controller.



CAUTION – Equipment Damage

Do not disconnect the Battery Fuse/Breaker under load. Refer to the startup & shutdown procedure above – Turn Off the PV Isolator first!

■ Programming the Device

When the CoolMax SRX is first powered on, the device will run a self-test and then the LED indication strip will flash yellow to indicate no charge profile has been configured.

The CoolMax SRX is programmed via the USB-B port located inside the access cover, as demonstrated in Figure 4 to the right.

The AERL Link Software for Windows 10/11 can be downloaded at the URL below.

 **www.aerl.com.au/aerl-link**

Instructions for setting the charge profile located on Page 18.


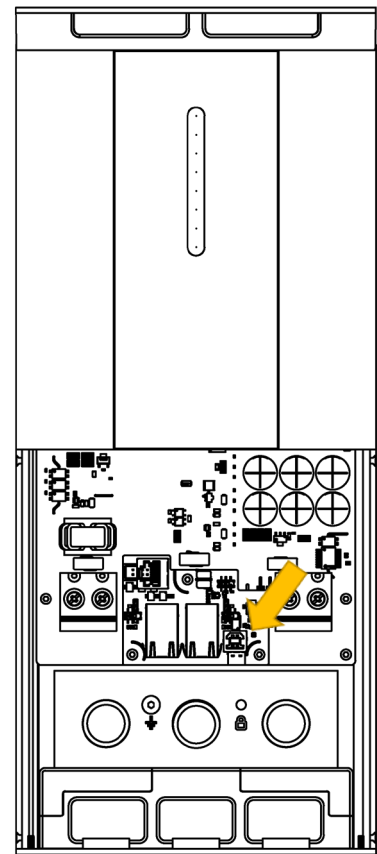


Figure 4:
USB-B Programming Port

■ Device Status Indicator

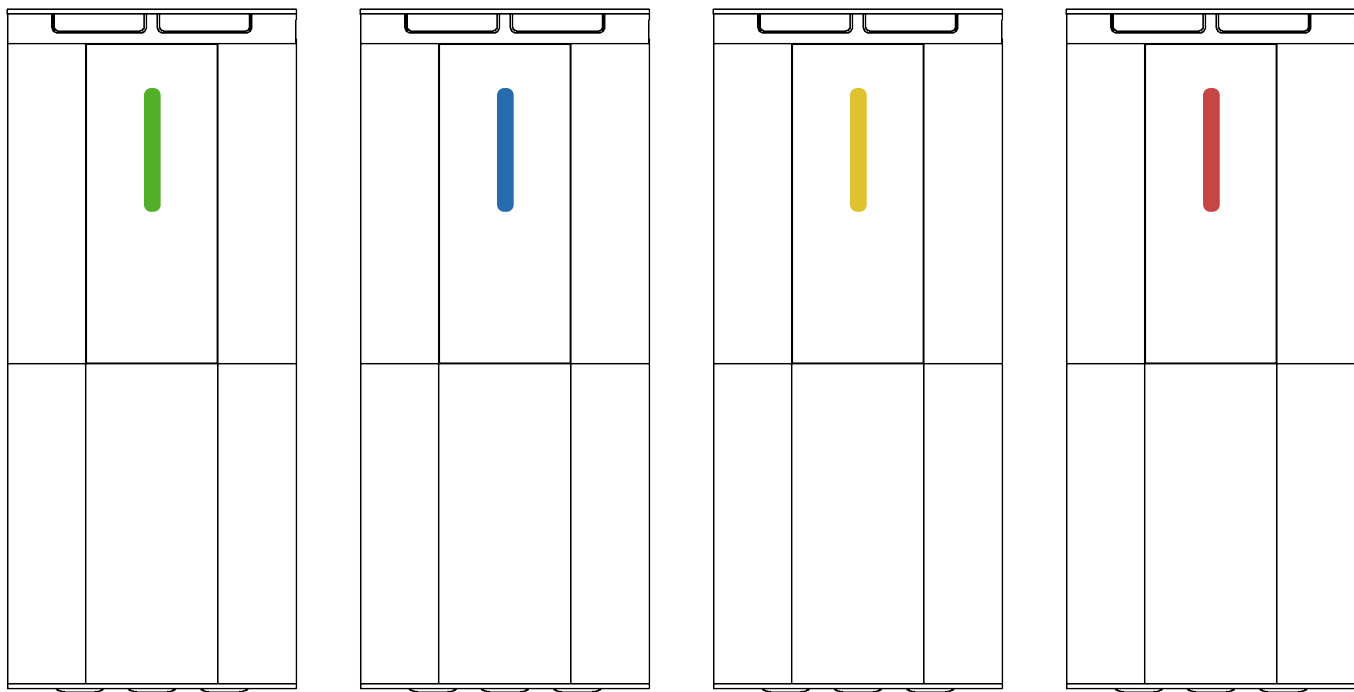

	FLASHING	SOLID
GREEN	REMOTELY CONTROLLED & OK	OK
BLUE	STARTING UP	SLEEPING
YELLOW	SETUP REQUIRED / FW UPDATE IN PROGRESS	N/A
RED	SYSTEM FAULT	HARDWARE FAULT

Figure 5: LED Indication States

■ Battery Charge Profile



IMPORTANT

The CoolMax SRX default charge profile is intended for a generic LiFePo4 battery solution.

AERL supports most other battery chemistries that do not require external BMS communications.

The CoolMax SRX charge output will not automatically activate for safety reasons. Prior to activating the charge output, the charge profile must be configured for the relevant battery solution being utilized.

The SRX operates using an advanced three-stage charging process and has pre-set charge voltage profiles for each supported nominal battery voltage. That said, AERL always recommends referring to the battery manufacturers specifications regarding charge voltages for optimal battery life and performance.

These voltages can be adjusted in the charge profile settings as demonstrated on [Page 18](#).

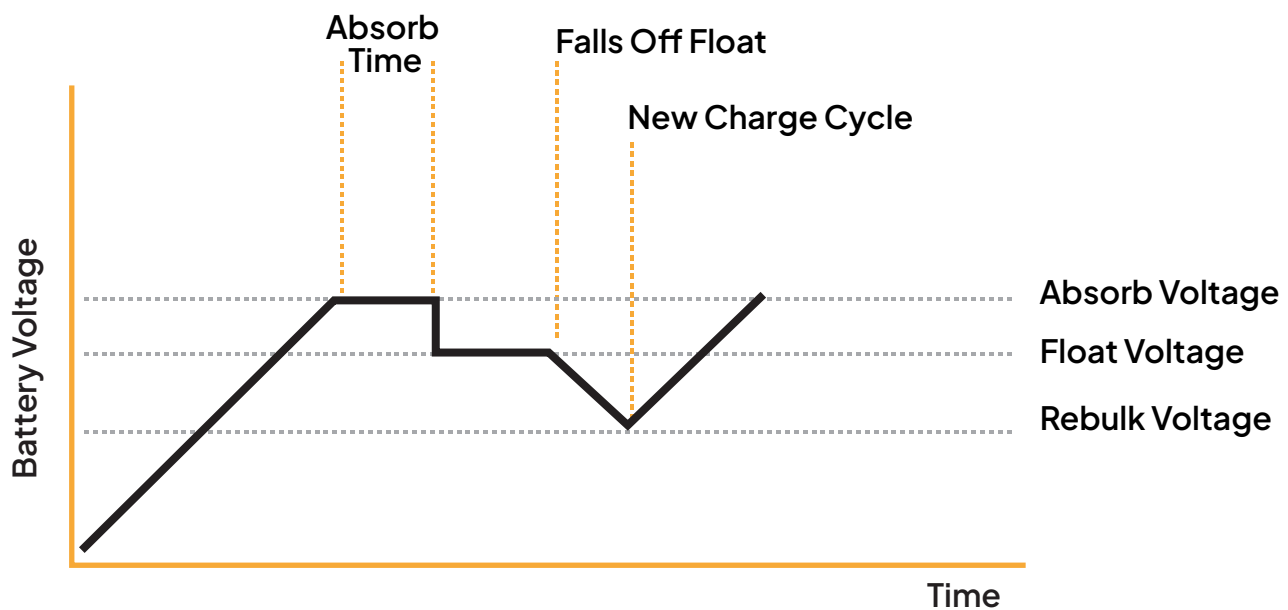


Figure 6: Battery Charge Profile Illustrated

■ Charge Profile Configuration

The CoolMax SRX allows for extensive flexibility when it comes to charge profile parameters to suit numerous different modern battery chemistries and manufacturers requirements.

Our programmable charge profile allows for the configuration of the Battery Charge Rate, and the Absorb, Float, Re-Bulk, and Equalization voltage points.



IMPORTANT

An Equalization is only normally required for Flooded Lead-Acid cells that experience sulfation because of poor charging practices over the lifetime of said cell.

Equalization is not required, nor recommended for LiFePo4 or other lithium-based battery solutions and will likely cause damage unless otherwise advised by the battery manufacturer.


The default charge profile is suitable for most applications but to determine the optimal charge profile for your application, please refer to your battery manufacturer's user manual or datasheet.

The CoolMax SRX Default Charge Profiles are as follows:


	SRX 600/55-48	SRX 600/70-48
Nominal Battery voltage	48 V	48 V
Max Charge current	55 A	70 A
Absorption voltage	56 V	56 V
Absorption time	2 Hours	2 Hours
Float Voltage	55.2 V	55.2 V
Re-Bulk Voltage	52 V	52 V

■ Setting the Battery Charge Profile with AERL Link


Connect to the USB-B Port on the CoolMax and **Select the Device** from the available local devices list.

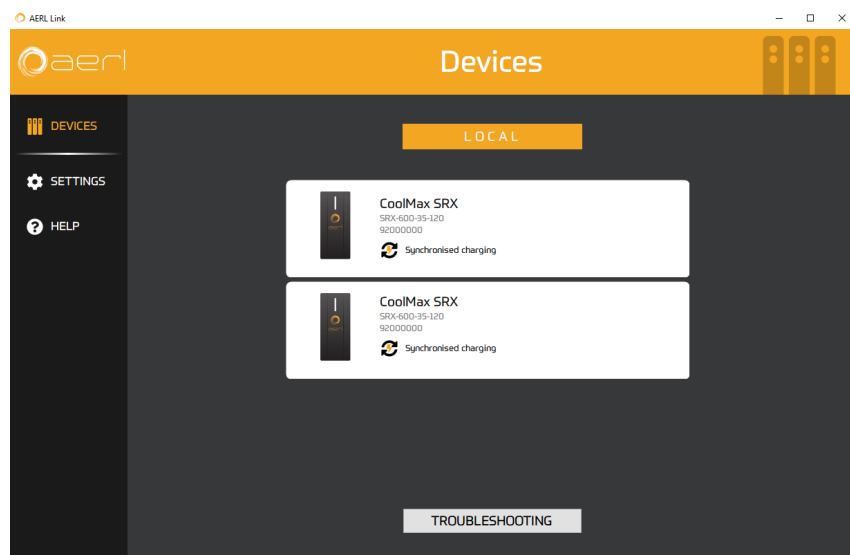

Select the Settings button to access the battery charging settings. Charge settings are changed by clicking on the setting value and using the plus/minus arrows or the keyboard to enter a new value.

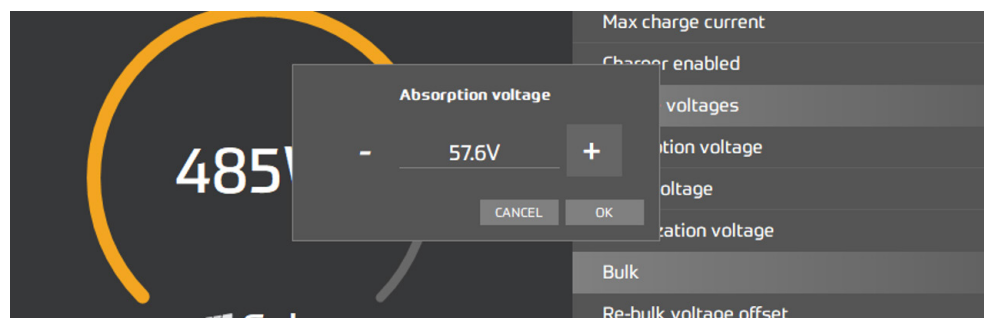

Once the required settings have been set, **Apply the Changes** to the CoolMax SRX by clicking on the **Apply** button.

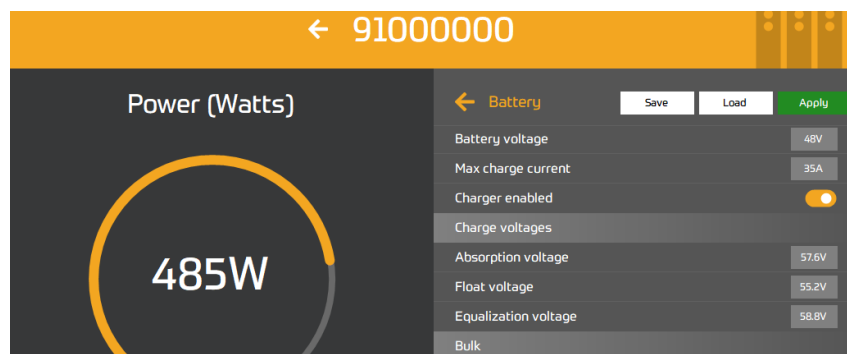

■ Battery Temperature Compensation



IMPORTANT

To utilize the CoolMax SRX battery temperature compensation functionality, an AERL Battery Sense Remote Temperature and Voltage Sensor will be required.

Part Number: BATT-SENSE

Temperature compensation measures the temperature of the batteries and adjusts the float and absorb voltage set points to the ideal voltage for batteries at that temperature.

Using the temperature of the batteries, the COOLMAX SRX adjusts voltages by a user specified factor in millivolts per °C. The temperature compensation factor can be set using the AERL Link Software. The compensation factor is per bank, not per cell.

Please refer to **Page 18** of this User Manual for instructions on how to edit settings in the charge profile.

■ Connecting the Temperature Sensor



IMPORTANT

A temperature compensation value must be set in the charge profile before the CoolMax SRX will begin to utilize the battery temperature.

To connect your remote temperature sensor to the CoolMax SRX, plug the sensor into one of the CAN RJ45 ports labelled “CAN” and located between the power terminals.

Insert the remote temperature sensor connector into the RJ45 connection (Make sure the orientation is correct and do not force the connection).

Once the connector is inserted, it will click into place.

■ Temperature Sensor Location

The CoolMax SRX remote temperature sensor must be near the battery cells for accurate results. Securing the temperature sensor in a central location near the top of the bank is recommended.



CAUTION – Equipment Damage

Do not place the Battery Sense Remote Temperature and Voltage Sensor in a location where it may be exposed to water, moisture, direct sunlight, or chemical material.

■ Earth Fault Detection

The CoolMax SRX features onboard PV and Battery system earth fault detection, with all connected electrical poles checked for insulation degradation during the device's start-up routine.

The device chassis must be connected to the same earth as the PV array for the ground fault detection to function. The chassis earth point is located inside the access cover and indicated with the symbol demonstrated below.



IMPORTANT

The system earth type configuration (**Ground Fault Mode**) must be adjusted in the AERL Link software for use with functionally earthed systems otherwise an earth fault will be detected on the earthed pole.

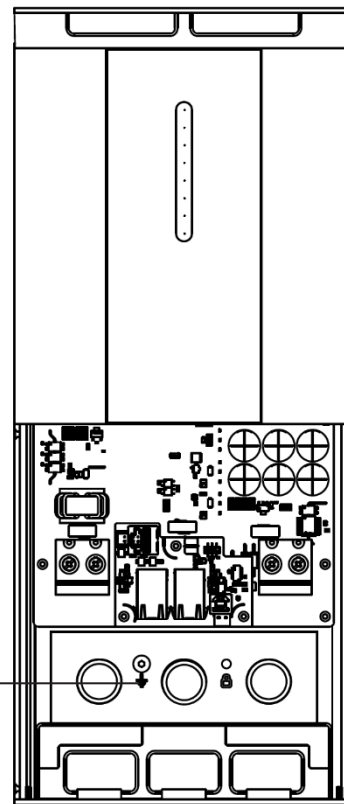


Figure 10: Chassis Earth Point

■ Earth Fault Sensitivity

The SRX earth fault detection offers three levels of sensitivity, all of which are compliant with the Australian PV installation standards.

High	< 100k Ω
Medium	< 50k Ω
Low	< 30k Ω

The sensitivity of the ground fault detection can be configured in AERL Link as demonstrated in Figure 11 on the next page.

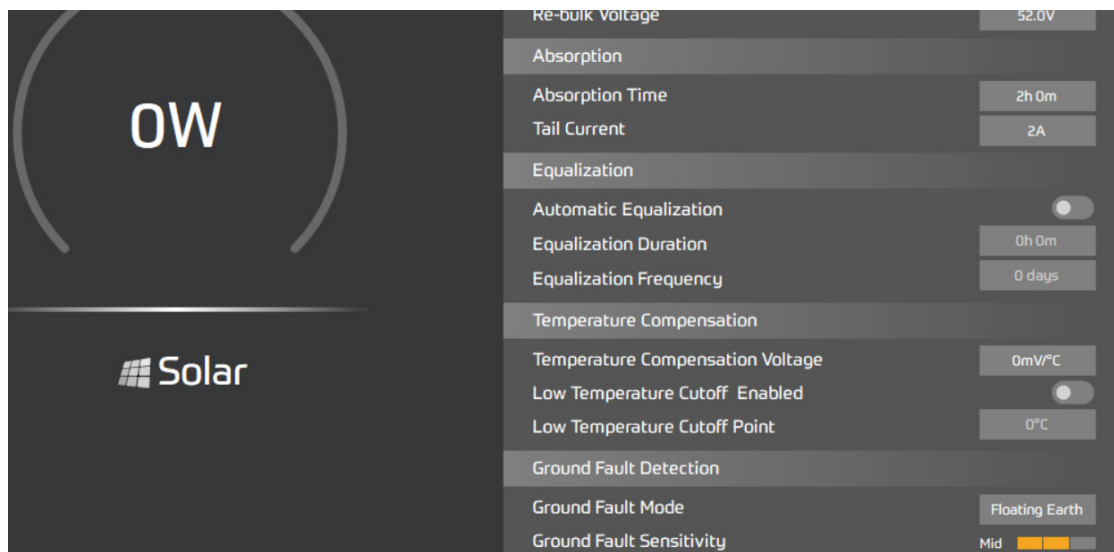



Figure 11: Earth Fault Sensitivity Adjustment

■ Communications Protocols

The CoolMax SRX features both Controller Area Network (CAN bus) and ModBus RTU (RS485) compatible protocols for remote monitoring and control functionality (CAN bus only).

The relevant protocol registry maps for integration are available from AERL on request.

Both networking protocols can be accessed via the RJ45 connectors located inside the access cover and the pinouts for these connections are demonstrated in Figure 12 below.

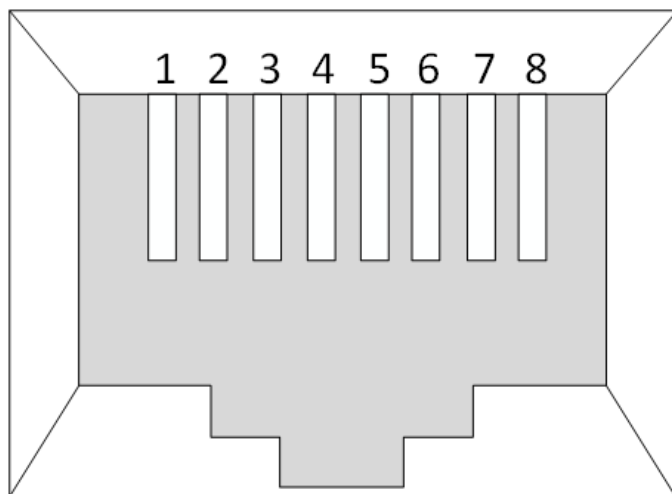

Pin	RS485 Connector
3	RS485 A
6	RS485 B
1, 2, 4, 5, 7, 8	GND
Pin	CAN Connector
3	+5V
4	CAN High
5	CAN Low
6	GND

Troubleshooting – Error Codes

If the CoolMax SRX detects an issue, a warning, or fault code will be triggered.

Please refer to the table below for Warning Codes and the tables located on **Page 21 & 22** for Fault Codes.

Warning Code	LED Code	Warning	Description	Recommended Action
-26	Flashing Yellow/Green	Device Not Configured	The initial setup process has not been completed and the device will not begin charging.	Connect and configure the device with the AERL Link Software. Refer to Page 14.
-1303	Solid Yellow/Green	Charger Disabled	The charger has been disabled via the Settings in AERL Link	Connect to the device and enable the charger to begin charging.
-1153	Solid Blue	Low Input Voltage Detected (Sleep Mode)	The PV Voltage is below the minimum allowed PV Voltage or not adequate to charge the connected battery.	Confirm PV String Configuration is appropriate for the device and the sun is shining. Note – This code may be shown during sunrise and sunset conditions.
-1304	N/A	Battery Sense Not Detected	The remote voltage and temperature sensor is either unplugged or faulty.	Refer to Battery Sense User Manual for troubleshooting.
-1301	Flashing Yellow/Green	CAN Master Lost	The device has not received information from the Master within the allowed time-out window.	Confirm your RJ45 connection has not been interrupted and the Master device is still active.
-1160	Flashing Yellow/Green	Configuration Out of Range	Set Point configuration is outside limits and may be dangerous for detected nominal battery voltage.	Confirm the Charge Profile is appropriate for the battery being charged. Refer to the Battery Manufacturer's recommendations.

Troubleshooting – Error Codes

Please refer to the table below for Fault Codes.

Fault Code	LED Code	Error	Description	Recommended Action
-1 to -99	Solid Red	Generic Hardware Fault	A hardware fault has been detected.	Please contact AERL to organize a warranty replacement.
-350	1 Flash - Red	No Output Detected	No output has been detected.	Power cycle the device and contact AERL if it reoccurs.
-1100	Solid Red	Internal Temperature Critical	The device's internal systems have reached a critical temperature and shutdown to prevent system damage.	The device will automatically restart when it's safe to do so.
-1159	2 Flashes - Red	Low Output Voltage	Low output voltage has been detected.	Confirm the battery is connected to the controller.
-1154	3 Flashes - Red	High Output Voltage	High output voltage has been detected.	Battery may be being charged from a secondary source. Confirm all system battery charge parameters.
-1157	4 Flashes - Red	High Output Current	High output current has been detected.	Confirm no short circuit is present on the output of the controller.
-1152	5 Flashes - Red	High PV Voltage	High PV Voltage has been detected. The device has shutdown to prevent system damage.	Confirm PV String Configuration is appropriate for the device.
-1156	6 Flashes - Red	High PV Current	High PV input current has been detected.	Confirm PV String Configuration is appropriate for the device.

Fault Code	LED Code	Error	Description	Recommended Action
-1051 -1052	Solid Red	Active Cooling Degraded	Degraded active cooling capability has been detected.	<i>Replace Fan Module.</i>
-1102	8 Flash – Red	High Battery Temperature Detected	The battery temperature sensor has detected a high battery temperature. Operating the battery at a high temperature will greatly reduce its lifespan.	<i>Consider increasing the battery temperature compensation factor with the AERL Link Software or reducing the ambient environment temperature.</i>
-1103	9 Flashes – Red	Low Battery Temperature Detected	The battery temperature sensor has detected a low battery temperature. Operating the battery at a low temperature will greatly reduce its lifespan.	<i>Consider a temperature-controlled battery environment if the battery regularly experiences low temperatures.</i>
-1401 -1402 -1403	10 Flash – Red	Earth Fault Detected	An Earth Fault has been detected.	<i>Disconnect the device, confirm the fault with a Megger, and repair the system.</i>

Note: The CoolMax troubleshooting guide and documentation is being improved regularly. If the relevant situation is not documented, please contact AERL.